


PLAN VIEW

EDGE OF CONCRETE FOOTING

L= 5'-0"  
W= 4'-0"

FORD RECTANGULAR PIT COVER  
W/ EXTENSION PLATE RM-1T

SECTION A

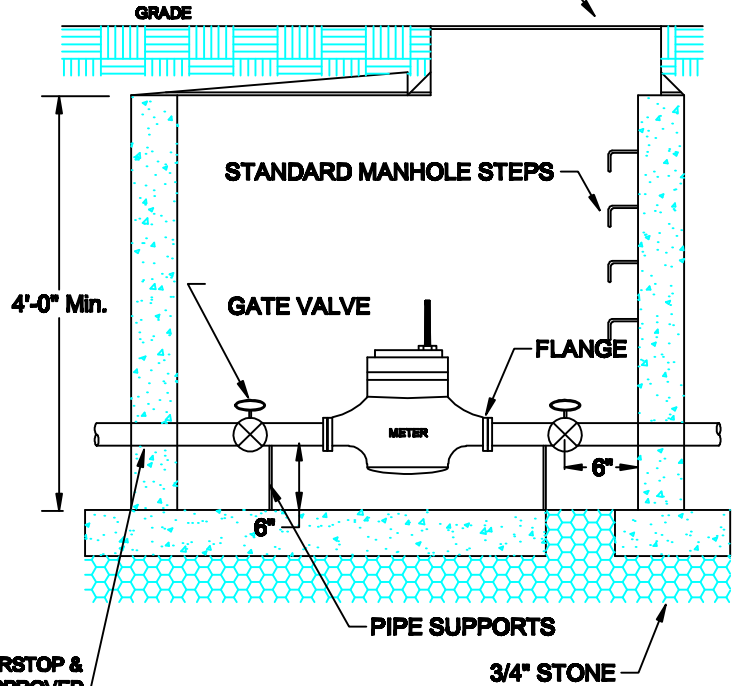

WALL SLEEVE WATERSTOP &  
LINK SEAL OR APPROVED  
EQUAL, SIZED TO SUIT WATER  
MAIN AT ALL PENETRATIONS

N.T.S.

1. CONCRETE SHALL ATTAIN A MINIMUM COMPRESSION STRENGTH OF 4000 PSI @ 28 DAYS
2. REINFORCING STEEL SHALL BE GRADE 60
3. LID SHALL BE FORD RM STYLE

FOR 1 1/2" METERS OR LARGER

# METER PIT

## JACKSON TOWNSHIP M.U.A.

NO.	DATE REVISD
5	
4	
3	
2	
1	MARCH 2010
	DRAWN FEB 2003
SHEET	4 OF 20

